

# Implementation of TCSC on a Transmission Line Model to analyse the variation in Power Transfer Capability

**Prof.Sushil Kumar**

Electrical and Electronics Deptt

Pragati college of Engg and Management Raipur

Email sk1\_bit@rediffmail.com

## **Abstract—**

*The FACTS controllers clearly enhance power system performance, improve quality of supply and also provide an optimal utilization of the existing resources. This paper discusses the development of a Thyristor Controlled Series Capacitor (TCSC) with open loop control system. The TCSC circuit and characteristics are discussed in brief. Next the determination of TCSC parameters is discussed. With these parameters the capacitive mode of operation of TCSC is simulated and implemented on a power system model with 300 km long transmission line. MATLAB R2006b software had been used as the simulation tool. Results of simulation made are discussed. Significant enhancement in the power transfer capability of transmission line is*

*observed with the inclusion of TCSC in the model.*

## **Keywords:**

**FACTS, TCSC, power quality, firing angle**

## **1. Introduction:**

### **Facts Definition:**

A **Flexible Alternating Current Transmission System** (FACTS) is a system comprised of static equipment used for the AC transmission of electrical energy. It is meant to enhance controllability and increase power transfer capability of the network. It is generally a power electronics -based device.

FACTS is defined by the IEEE as "a power electronic based system and other static equipment that provide control of one or more AC transmission


system parameters to enhance controllability and increase power transfer capability."

**TCSC:**

Thyristor Controlled Series Capacitor (TCSC) is a Flexible AC Transmission Systems (FACTS) device. It has proven to be an excellent solution in controlling the power flow, especially over long transmission lines where the power angle control at either end of the line are constrained. The TCSC can also be used for damping power oscillations and mitigating subsynchronous resonance.

**2. Fundamentals:**

Series compensation has been utilized for many years with excellent results in AC power transmission in a number of countries all over the world. The usefulness of the concept can be demonstrated by well-known expressions relating to active power transfer and voltages.

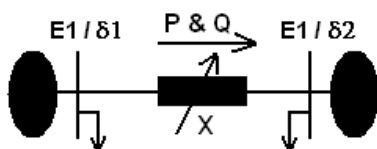

**Fig. – 1**

**Series Compensation**

$$P = \frac{E_1 \cdot E_2 \sin \delta}{X}$$

.....(1)

$$V = f(P, Q)$$

.....(2)

Here, in fig.1, E1 and E2 denote the voltages at either end of the interconnection, whereas δ denotes the angular difference of the voltages (E1&E2). X is the reactance of the transmission circuit, while P and Q denote the active and reactive power flow.

From (1) it is evident that the flow of active power can be increased by decreasing the effective series reactance of the line. Similarly it is demonstrated that by introducing a capacitive reactance in the denominator of (1), it is possible to achieve a decrease of the angular separation with power transmission capability unaffected, i.e. an increase of the angular stability of the link.

FACTS devices are used for the dynamic control of voltage, impedance

and phase angle of high voltage AC transmission lines. Different FACTS devices in the power system are Static Var Compensators (SVC's), Thyristor controlled series compensators (TCSCs), STATCOMs, Unified Power Flow Controller (UPFC).

In this work, only TCSCs had been used for simulation, study and analysis.

### 3. Basic Structure of TCSC:

The basic structure of TCSC is shown in Fig.2. It is mainly constituted by four parts: series compensating capacitor C, bypass inductance L, bidirectional thyristor SCR and zinc oxide voltage limiter MOV.

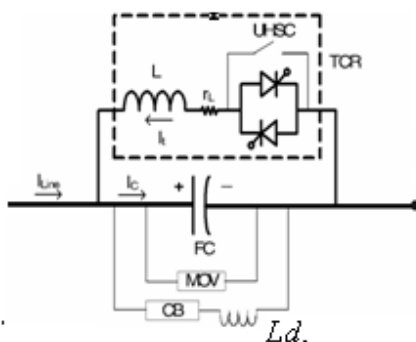


Fig. 2 TCSC Module

The degree of TCSC basic compensation is controlled by the capacity size of capacitor C. The main function of bypass inductance L is to reduce the short circuit current and the energy absorbed by MOV.

Bidirectional thyristor SCR is used to transform the equivalent impedance of TCSC which fulfill the needs in all kinds of power system condition, such as improving the stability, increasing the transmission capability, restraining hyposynchronization resonance and so on.

By controlling the trigger pulse, TCSC can transform the trigger angle of thyristor. Subsequently, the current value of inductance subcircuit which controlled by TCSC can be transformed, and then the total equivalent impedance will be changed continuously.

Generally, when the trigger angle is  $145^\circ \sim 180^\circ$ , the equivalent impedance of TCSC is appeared as capacitance. When the trigger angle is  $90^\circ \sim 140^\circ$ , the equivalent impedance of TCSC is appeared as inductance as which characteristic can restrict short circuit current during system failure. A circuit breaker is also installed across the

TCSC module to bypass it if a severe fault or equipment malfunction occurs. A current limiting inductor,  $L_d$ , is incorporated in the circuit to restrict both the magnitude and the frequency of the capacitor current during the capacitor bypass operation.

$$X_{1TCSC} = \left( \frac{X_{1TCR} \cdot X_C}{j \cdot (X_{1TCR} \cdot X_C)} \right) \dots\dots\dots(3)$$

$$X_{2TCSC} = -j \cdot X_C \left[ 1 + \frac{2}{\pi} \cdot \frac{\lambda^2}{\lambda^2 - 1} \left\{ \frac{2 \cdot \cos^2 \frac{\sigma}{2}}{\lambda^2 - 1} \cdot \left( \lambda \cdot \tan \left( \lambda \frac{\sigma}{2} \right) - \tan \left( \frac{\sigma}{2} \right) \right) - \left( \frac{\sigma}{2} \right) - \frac{\sin(\sigma)}{2} \right\} \right] \dots\dots\dots(4)$$

where ,

$$X_{1TCR} = j \cdot \omega \cdot L \cdot \left[ \frac{\pi}{\sigma - \sin(\sigma)} \right] \dots\dots\dots(5)$$


$$\lambda = \frac{\omega_0}{\omega_N} \dots\dots\dots(6)$$

$$\omega_0 = \frac{1}{\sqrt{L \cdot C}} \dots\dots\dots(7)$$

In the above equations,  $\sigma$  is the conduction angle, L is the inductance of the TCR inductor, C is the capacitance of the fixed capacitor,  $\omega_N$  is power system frequency in radians per second and  $\omega_0$  is the resonant frequency of the TCSC circuit. Fig. 3 shows the reactance characteristics of TCSC.

#### 4. Effective reactance of TCSC:

The effective reactance of TCSC is given by equations (3) and (4). Equation (3) assumes that the capacitor voltage is free from harmonics and considers the only the TCR current harmonics.

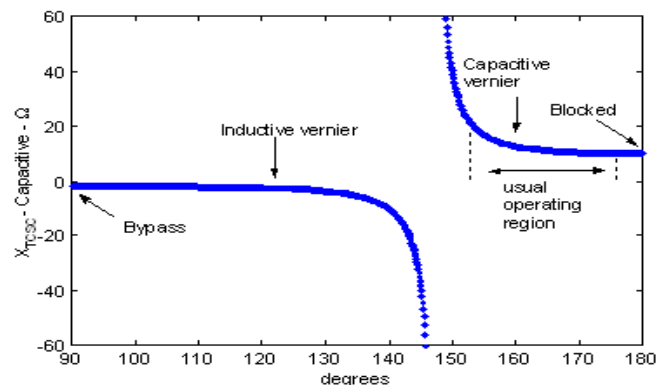

**Fig.-3. Reactance Characteristics of TCSC**

## 5. Simulation of transmission Line with TCSC:

### 5.1 Description of the system model:


A 735 kV, 300 km line is used to transmit power from bus B1 (735 kV equivalent system) to bus B2 where RL load (P=1000MW and Q= 10e3 var) is connected. In order to simplify, only one phase of the system has been represented.

The nominal compensation is 75%, i.e. using only the capacitors (firing angle of 90deg). The natural oscillatory frequency of the TCSC is 150.6 Hz, which is 2.51 times the fundamental frequency

From the simulated model, system performance characteristics had been analysed without a TCSC and with a TCSC is connected at mid point of the transmission line.

### 5.2 The simulated model:

It is shown in fig. 4 below.


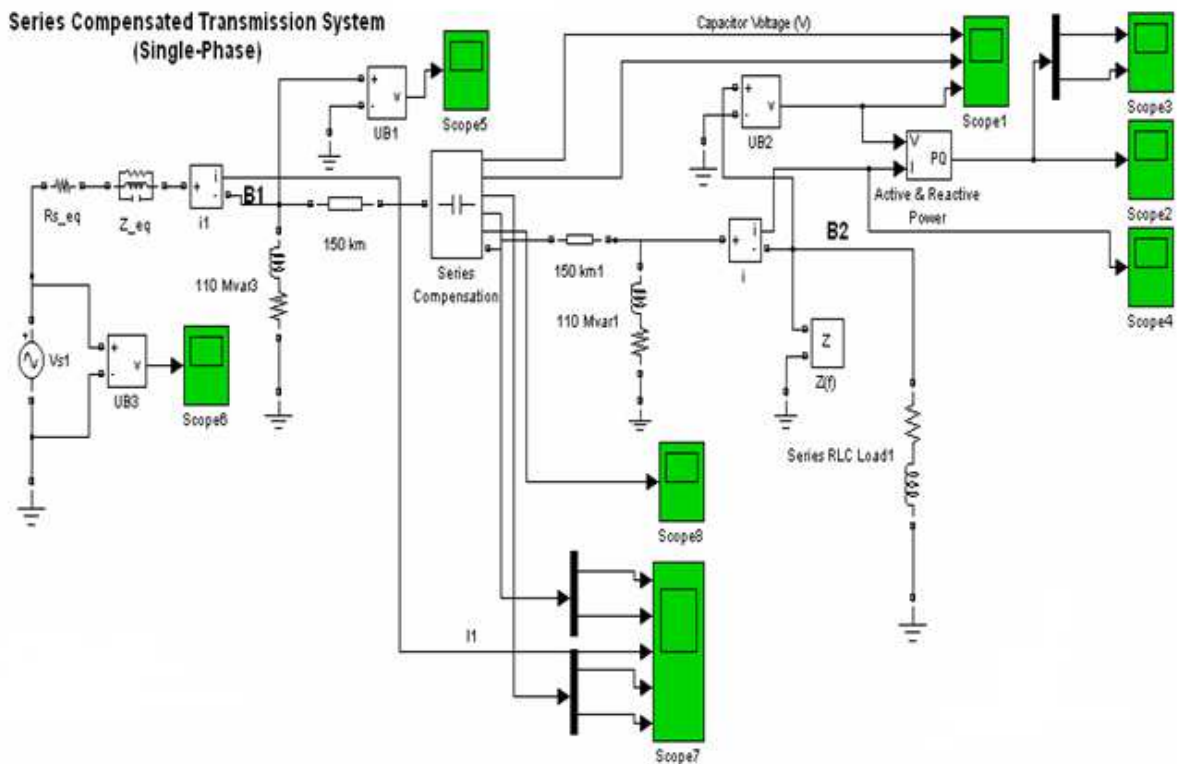


**Fig.-4. Simulation of TCSC (on transmission system)**






**Fig.-5. (a) Active, reactive Power at  $\alpha=146^\circ$  (b)  $V_c$ ,  $I_{cr}$  & voltage at B2 at  $\alpha=146^\circ$**

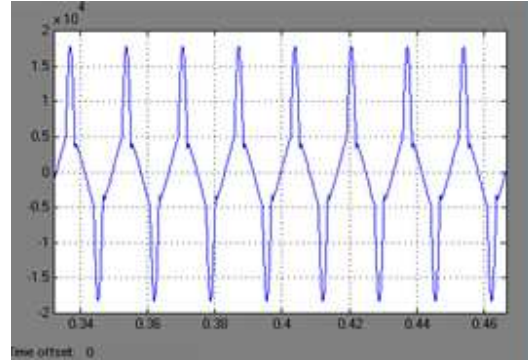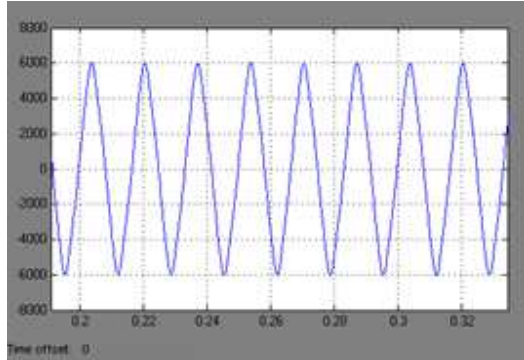

**(c) Line current ( $I_L$ ) at B2**

**(d) Capacitor current( $I_c$ )**

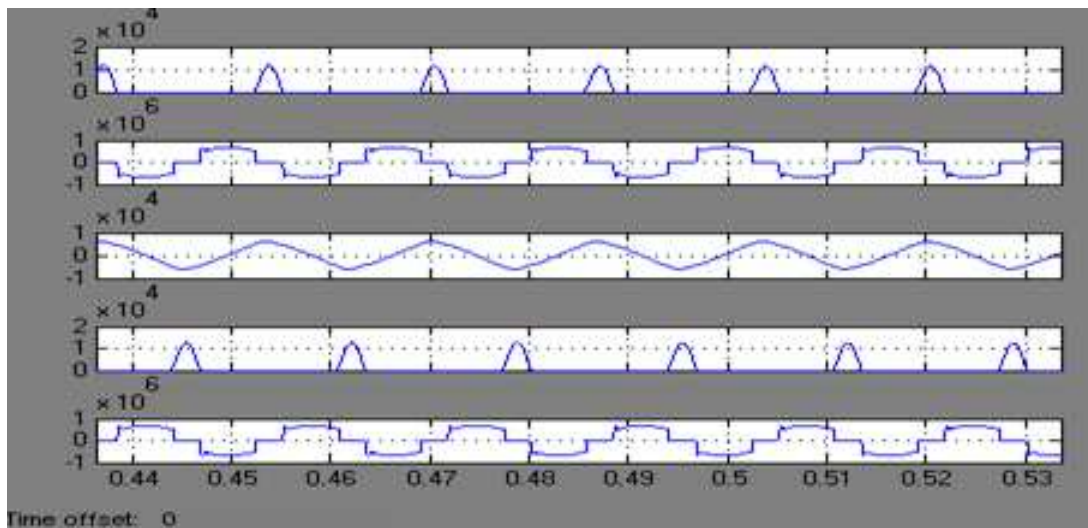

**(e) Waveforms of  $I_{ak1}$ ,  $V_{ak1}$ ,  $I_{line}$ ,  $I_{ak2}$  &  $V_{ak2}$**

In the model considered (Fig.4), TCSC is operated in capacitive mode keeping firing angle(delay angle)  $\alpha = 146^\circ$  the corresponding Active/Reactive power ,capacitor voltage , capacitor current ,TCR current and current at node B2 are given below.

Active power (P)	=	1540 MW
Reactive Power(Q)	=	150 MVAR
Capacitor voltage (V)	=	650 KV
Capacitor current( $I_c$ )	=	18 KV
TCR current	=	10 KA

Line current (B2) = 6 KA

## 6. Conclusion:

It is observed that with the inclusion of TCSC, power transfer capacity increased to 1540 MW. The same power was only 685 MW without any compensation. In simulations, with different firing angles, power level had been varied and the corresponding change in reactive power is also observed.

## 7. References:

- [1] Narain G. Hingorani, Laszlo Gyugyi, and Understanding FACTS: Concepts and Technology of FACTS, Wiley-IEEE Press, and December 1999.
- [2] Google search (FACTS Theory) from Wikipedia, the free encyclopedia (Wiley- IEEE Press, December 1999 and Modelling and Control, Springer, March 2006
- [3] Thyristor-Controlled Series Compensation: A state of the art approach for optimization of transmission over power links R. Grünbaum Jacques Pernot, ABB Power Systems.
- [4] Design of TCSC for Classroom and Research Applications on an Analog Model Power System Vinod K. Yedidi, *Student Member IEEE*, Brian K Johnson, *Member IEEE*. 2006
- [5] Power Grid Corporation India Limited, Raipur.
- [6] Klaus Habur is Sr. Area Marketing Manager, Reactive Power Compensation, Power Transmission and Distribution Group (EV) of Siemens AG in Erlanger, Germany. Donal O'Leary, Sr. Power Engineer of the World Bank is on assignment with the Siemens Power Generation Group (KWU) in Erlanger.